


# Estimated Demand Response Activity July 25, 2016

July 28, 2016

- Following charts depict:
  - All economically scheduled demand response across PJM for July 25, 2016.
    - No Load Management (demand response with capacity requirement) was needed to manage the system.
  - BGE Zone load curve depicting instantaneous impact of economically scheduled demand response.
    - Actual reductions achieved will be known after all individual customer meter data is provided for settlements – submission deadline for economic energy settlements is 60 days following event.

## Estimated Economic Demand Response in PJM: July 25, 2016

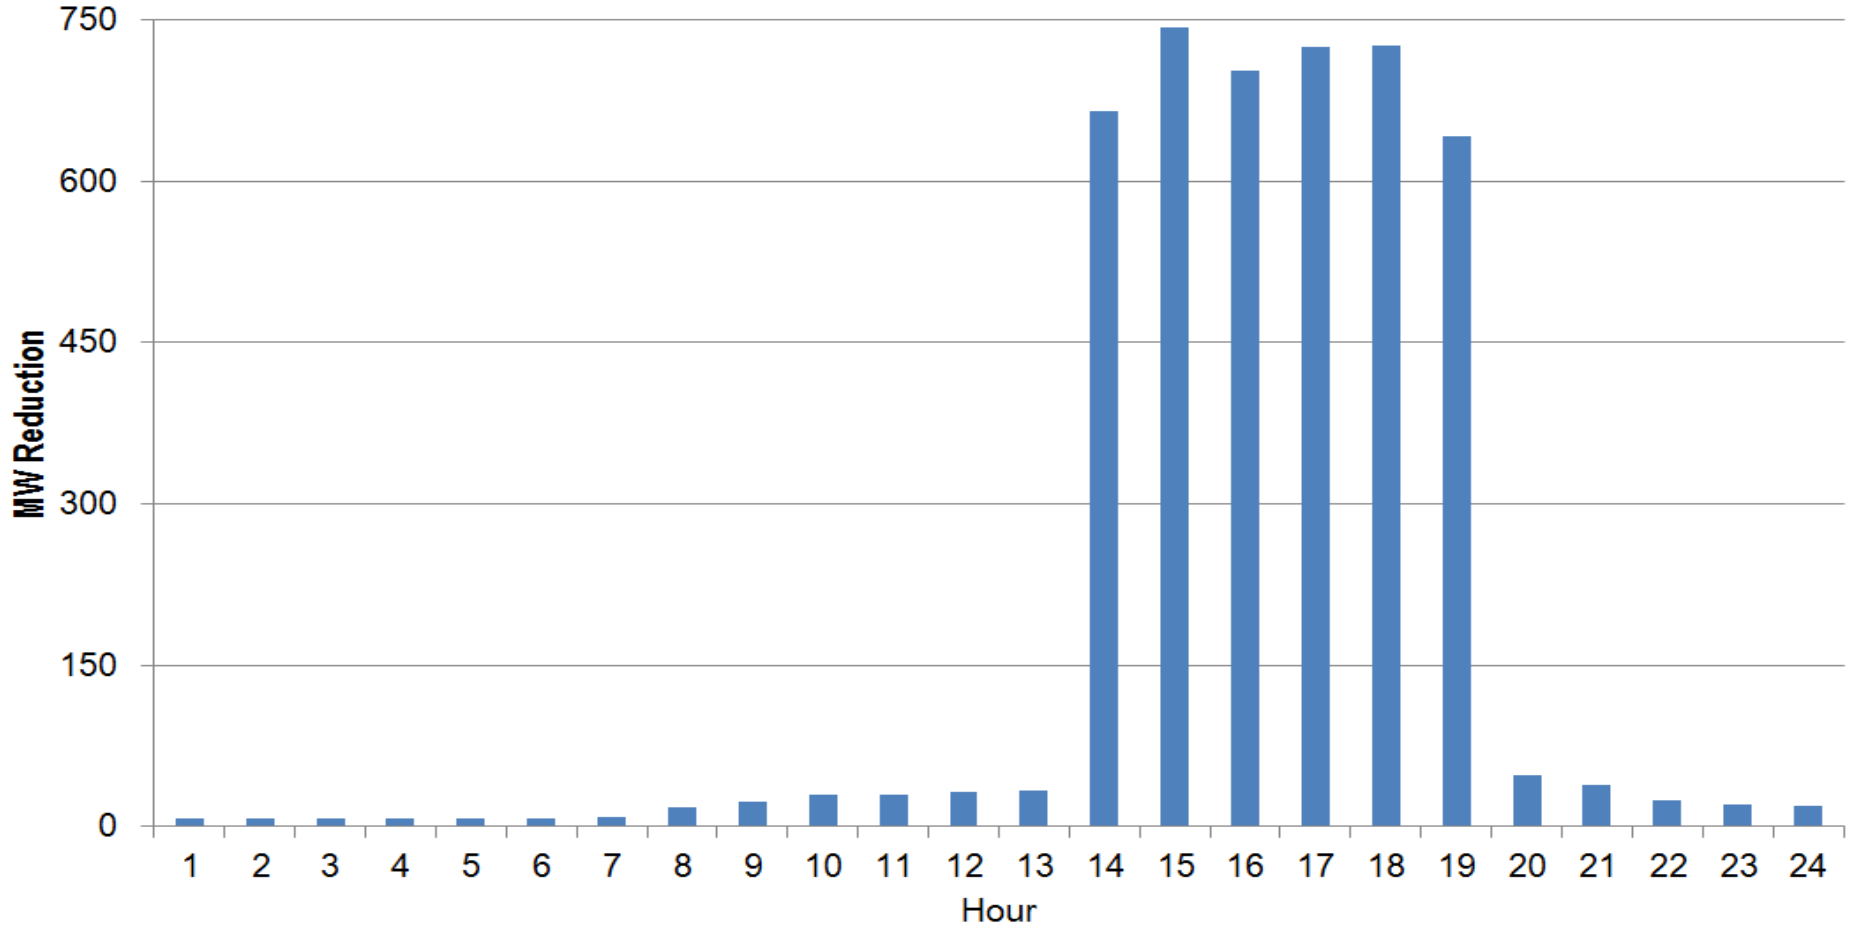

*Notes:  
Actual load reductions are not finalized until up to 3 months after event.*

