


# Coordination Trade-Off

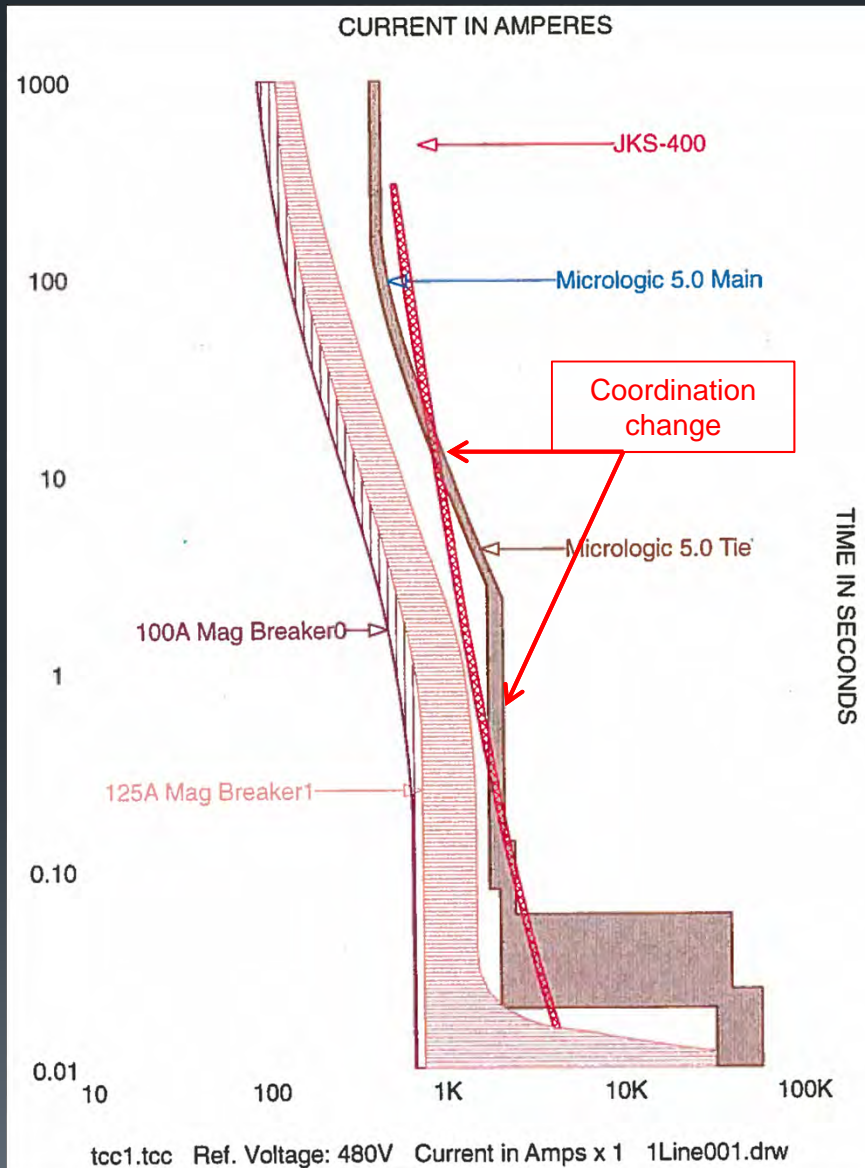

- Using a fast-acting fuse has affected the coordination with downstream breakers
- For a non-arcing fault of 1-2 kA between 52-2 and the AC Distribution Cabinet, the fuse will open before the breaker operates