



Extended Winter 2020-21 Transmission Outage Review

Marilyn Jayachandran,
Sr. Engineer, Transmission Operations
Operating Committee
October 08, 2020


Background

- **Susquehanna T21 (500/230 kV) Transformer Replacement**

- Transformer gas testing trends have shown deteriorating oil conditions which can lead to catastrophic failure due to age.
- Replacement ensures reduced risk to system reliability

- **Susquehanna 500 kV Relay Replacement**

- New Microprocessor relaying
- Improves system reliability

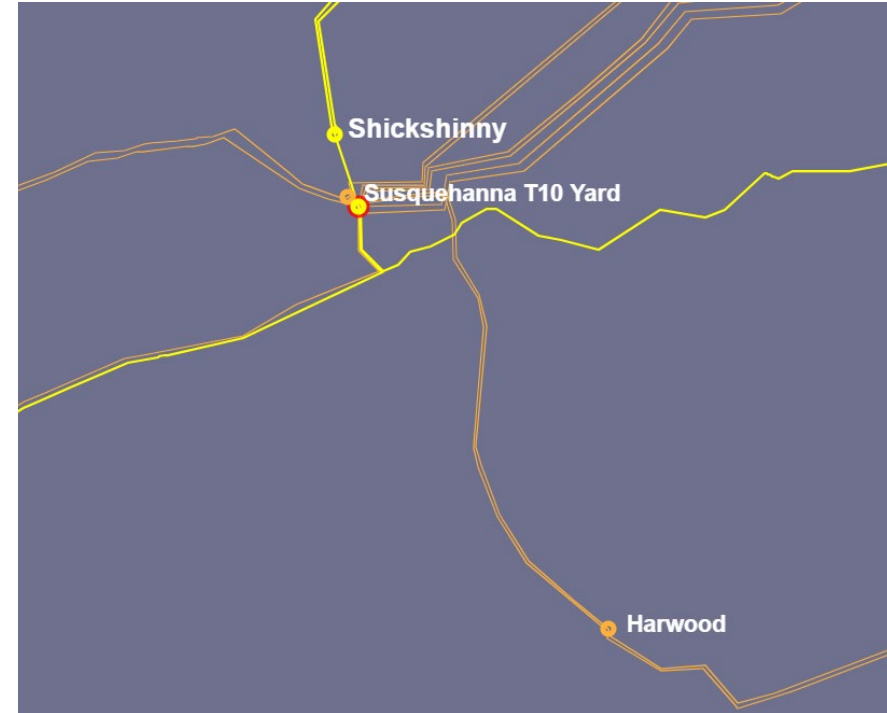

- **Project Timeline:** Sep 01, 2020 to June 18, 2021
- **Susquehanna T21 Replacement Outage :**
 - eDART 826161 - 10/12/2020 to 04/08/2021

- Nature of work requires outage to go over at least 1 peak period (summer or winter) – Winter was preferred due to lower expected seasonal peak (when compared to summer) .
- N-1 Studies indicate no reliability concerns.
- No stability issues identified in the peak.
- Depending on system conditions, may require generation re-dispatch to mitigate thermal, voltage or stability concerns.

SME/Presenter:
Marilyn Jayachandran
Marilyn.Jay@pjm.com

Extended Winter 2020-21 Transmission Outage Review



Member Hotline

(610) 666 – 8980

(866) 400 – 8980

custsvc@pjm.com