

Manual 03A, Rev. 20

Energy Management System (EMS) Model Updates and Quality Assurance (QA)

Suzie Fahr, Sr. Analyst II
Power System Modeling Department
Operating Committee
August 12, 2021

- Periodic Review
- Compliance Reliance ACA Update
 - Updated Section 2.2 to clarify instructions for a Transmission Owner to add, remove, and/or convert a flow device and submit the associated ratings.

Manual 03A: Energy Management System Model Updates and Quality Assurance, [Revision 20](#)


2.2 Model Information and Data Requirements

Flow ~~Circuit Breakers (Flow CB)~~ Devices

A flow ~~breaker device~~ in the PJM EMS model is a representation of a flow disrupting element (i.e., circuit breaker, disconnect, air break, or similar elements) that has been set up to calculate a ~~SE State Estimator~~ flow across it and ~~a~~ thermal ratings ~~are~~ also applied to that ~~flow device breaker~~, similar to a line or transformer. The ~~f~~Flow ~~device~~ CB must be able to calculate net if gross output is available, or calculate gross output if net is available.

To change an existing PJM-modeled element ~~circuit breaker~~ to ~~aa~~ ~~f~~Flow ~~device~~ CB, TOs must submit a Network Model ticket via <https://esuite.pjm.com/mui/> as part of the Model Build process. The ticket must clearly state if an element ~~CB~~ is being changed to a ~~f~~Flow ~~device~~ CB, or if it is a brand new ~~flow device~~ CB. TOs must then provide ~~the~~ ~~Flow CB~~ equipment ratings ~~via the~~ ~~shall be provided in~~ TERM application through a similar process to line and transformer ratings updates.

Manual 03A, Rev 20 Review / Approval Timeline

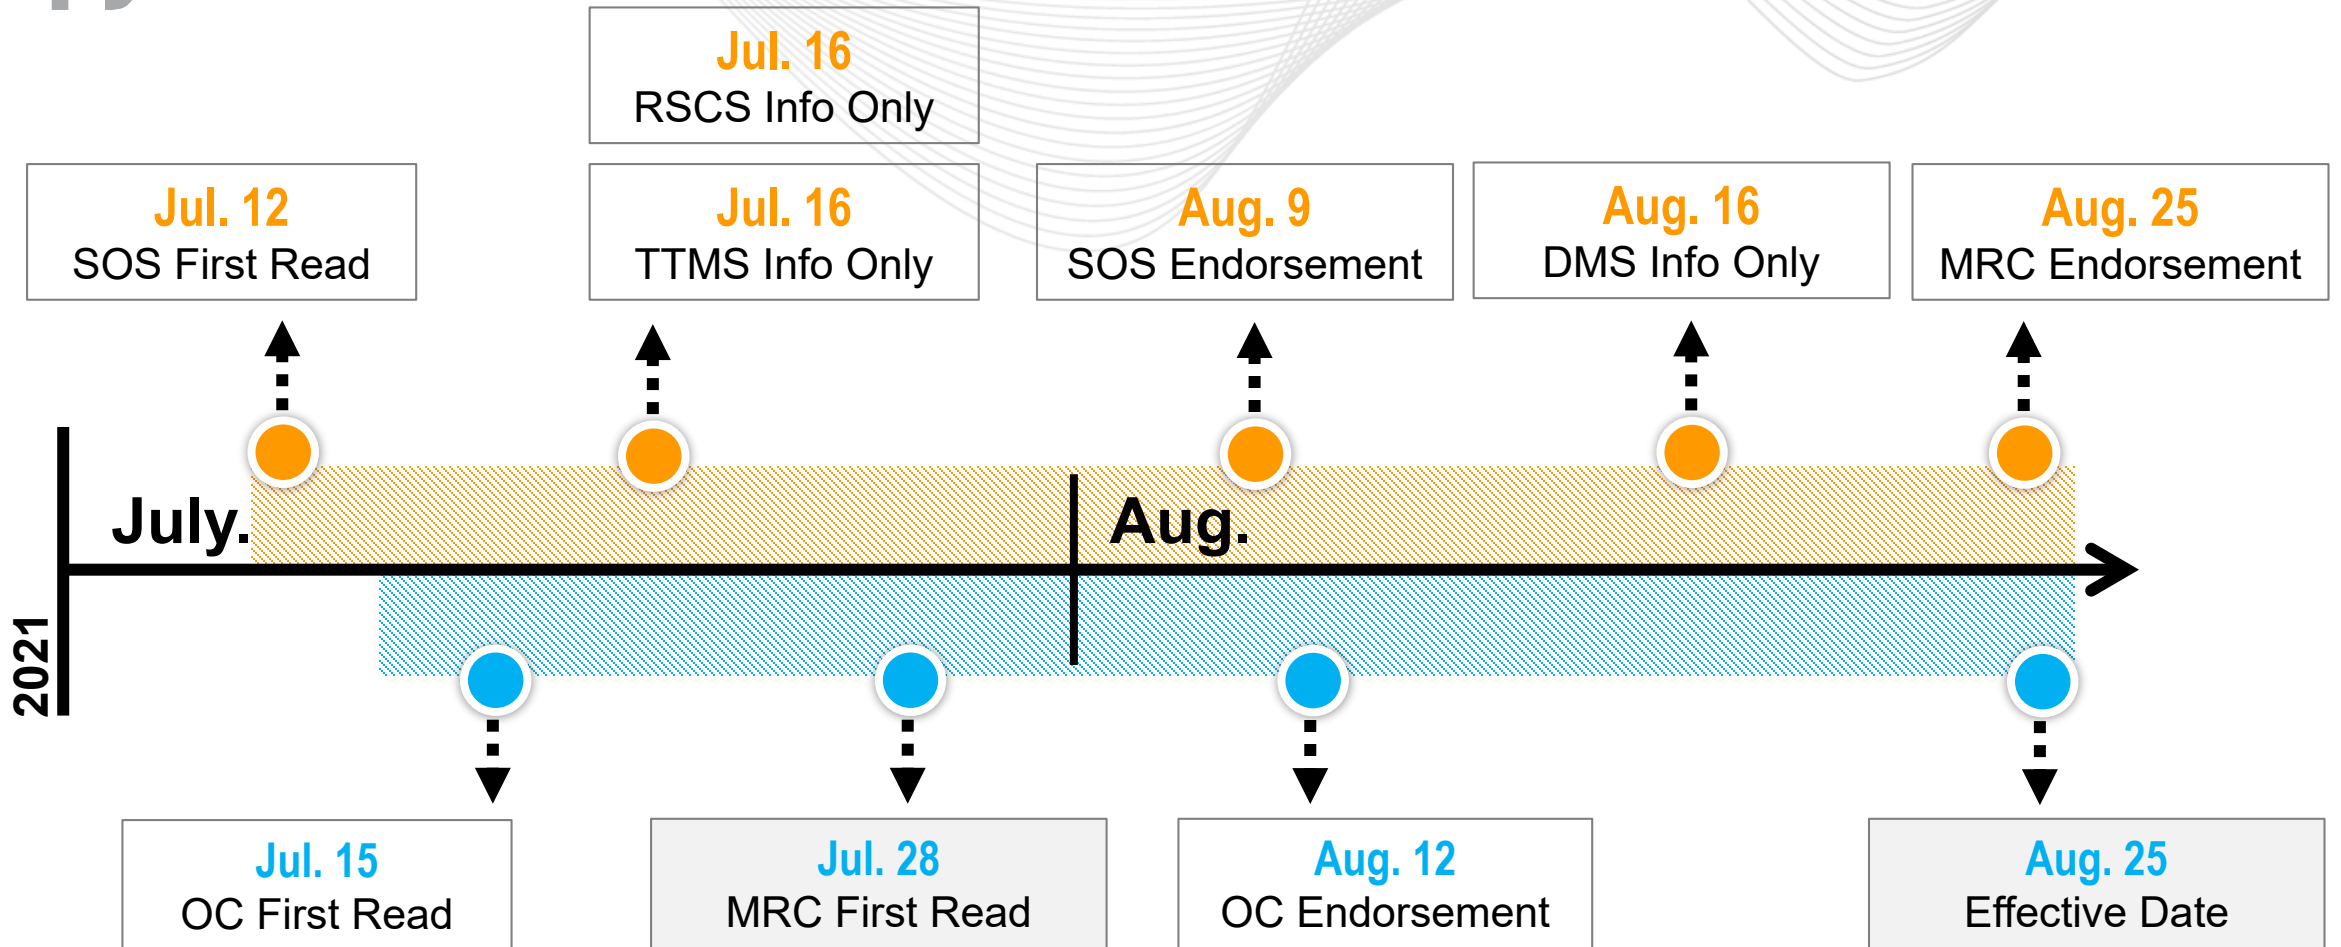

Facilitator:

Darlene Phillips,
Darlene.Phillips@pjm.com

Secretary (interim):

Lauren Strella Wahba,
Lauren.StrellaWahba@pjm.com

SME/Presenter:

Suzie Fahr,
Suzie.Fahr@pjm.com

Manual 03A, Rev 20



Member Hotline

(610) 666 – 8980

(866) 400 – 8980

custsvc@pjm.com