




Interregional Planning Update

NYISO-PJM Joint Stakeholder Meeting

April 2, 2017

Ken Seiler Executive Director - System Planning


- On-going Coordination activities
 - Interconnection Queue
 - Modeling and Data Exchange
 - Monthly calls to discuss interconnection projects that impact the neighboring system
- Eastern PJM / NYISO Interface

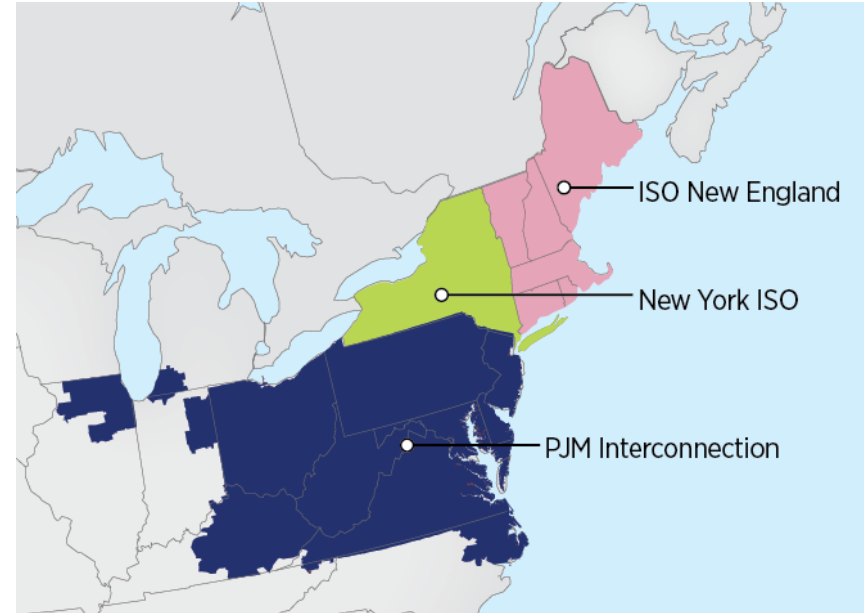


- Order No. 1000 planning
 - NYISO and ISO-NE IPSAC stakeholder group
 - May and December 2017 IPSAC web conferences
 - Reviewed Regional transmission issues and solutions, generator deactivation coordination, interconnection queue coordination
 - Determined that there were no opportunities for more efficient or cost effective interregional projects

- **Lake Erie Connector (Y3-092)**

- Merchant transmission request for a new HVDC line from Erie West substation in Penelec region to the Ontario IESO system. 1,000MW Capacity Transmission Injection Rights and 500MW Firm Transmission Withdrawal Rights, and 500 MW Non-Firm Transmission Withdrawal Rights
- PJM expects to complete Facilities Study in 3Q 2018.
- NYISO working on Facilities Study requiring the installation of a PAR on the Dunkirk-South Ripley 230 kV line in New York.

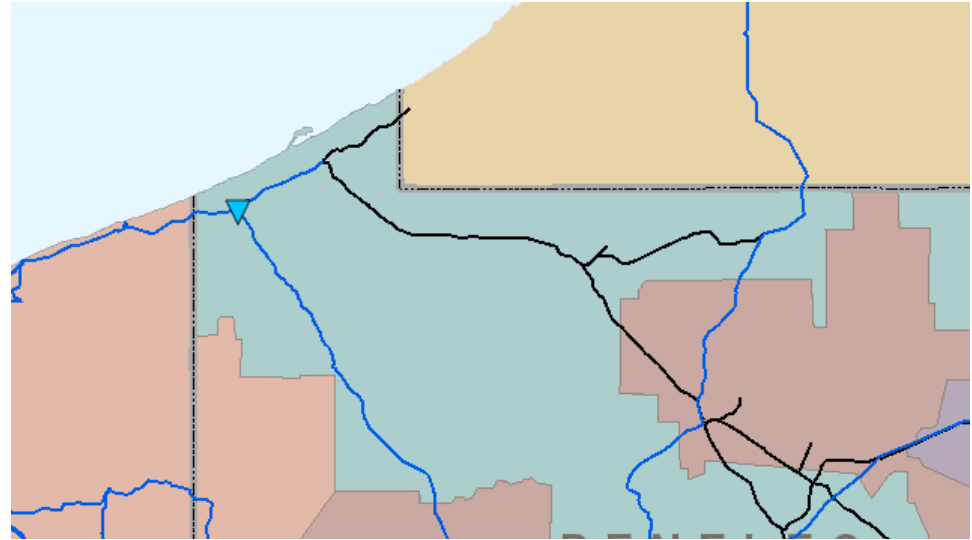

- Renovo (AA1-111) – Generation interconnection request in PJM's queue
 - Request for a 463 MW natural gas generator connecting to the Moshannon-East Towanda 230 kV line in Penelec
 - PJM working on Facilities Studies. NYISO performing Facilities Study to mitigate issues in New York
- Renovo (Q496) – Generation interconnection request in NYISO's queue
 - Request for a 480 MW natural gas generator connecting to the Homer City-Watercure 345 kV line
 - Proposed generator uses the same property as the PJM AA1-111 project but is a separate generator
 - The Moshannon-East Towanda 230 kV and Homer City-Watercure 345 kV lines share the same corridor in this area of Pennsylvania.
 - NYISO working on Facilities Studies. PJM performing Facilities Study

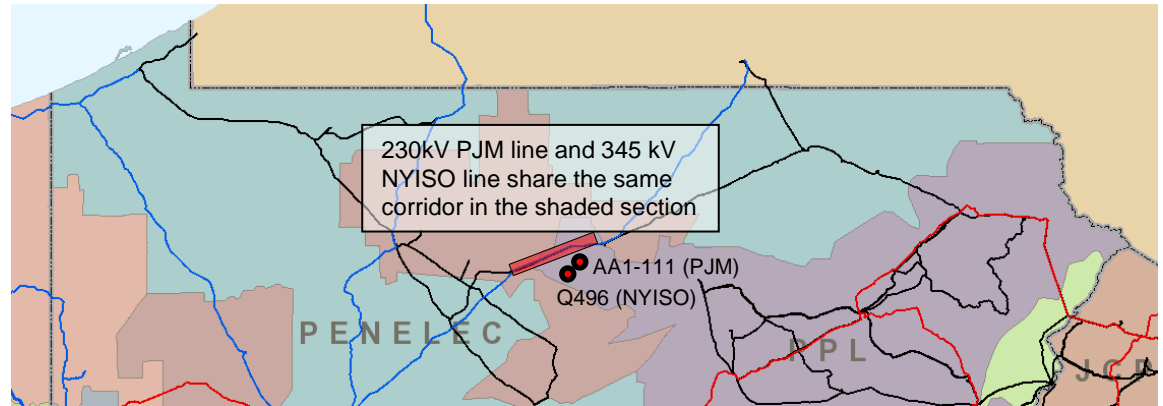

<http://www.pjm.com/library/reports-notice/rtep-documents.aspx>

Book 1: RTEP In Review



Book 1 provides an executive summary of reliability, market efficiency and operational performance studies. Results from a number of these studies drove RTEP proposal windows which are also summarized. Book 1 goes on to discuss generation fleet changes driven by plant deactivation and new natural gas plant interconnection. RTEP process enhancements completed or initiated in 2017 are also presented.

Book 1 [PDF](#) (9MB)

Book 2: Inputs and Process



Book 2 focuses on input parameters (e.g., load forecasts, generation and topology) and study methodologies (e.g., deliverability) used to conduct PJM's 2017 RTEP process cycle of studies. Book 2 also describes NERC and regional planning criteria.

Book 2 [PDF](#) (9MB)

Book 3: Studies and Results



Book 3 presents specific results from studies conducted throughout 2017 including baseline reliability, market efficiency, operational performance, transmission owner criteria analyses as well as scenario and interregional studies. Book 3 also summarizes RTEP window activity during 2017. Subregional summaries are also provided.

Book 3 [PDF](#) (30MB)



QUESTIONS?
