

Calculation of Forced Outage Probability and the ORDC

EPFSTF

January 23, 2019

John Hyatt



Monitoring Analytics

PJM Forced Outage Distribution

- **PJM's approach to the inclusion of forced outages in the ORDC is not accurate.**
- **PJM's approach overstates the forced outage MW and the ORDC.**
- **PJM's approach assumes that all units are always online.**
- **PJM's approach misses the fact that there is a significant probability of zero outages for each 30 minute time horizon.**
- **The examples in this presentation illustrate the general problem with PJM's approach.**

PJM Forced Outage Distribution

- **PJM's ORDC includes an increase in demand for reserves based on an assumed distribution of generator forced outage rates.**
- **PJM's proposed probability distribution for the forced outage rate is based on all generators with capacity rights (excluding solar and wind).**
- **For each season/time block, PJM forms a probability distribution of forced outage MW by multiplying the forced outage rate distribution by the average load for the season/time block.**

Forced Outage Probability Distribution

- **Online Generators for June 18, 2018, Hours 15 -18**
 - **819 generators**
 - **150,980.3 MW capacity**
 - **Average MTTF 2,290.5 (MTTF: mean time to failure)**
 - **Probability of no forced outages is 0.14**
 - **Probability of forced outage MW \leq 20 MW is 0.32**
 - **Mean 145.7 MW**
 - **Standard Deviation 200.2 MW**


Forced Outage Probability Distribution

- **PJM – All generators with capacity rights**
 - **1,229 generators**
 - **184,731.3 MW capacity**
 - **Average MTTF 1,664.0 (MTTF: mean time to failure)**
 - **Probability of no forced outages is 0.0000319**
 - **Probability of forced outage MW \leq 20 MW is 0.000389**
 - **Mean 447.9 MW**
 - **Standard Deviation 297.2 MW**


Forced Outage Probability Distribution

- **PJM – All generators with capacity rights with seasonal adjustment for summer, time block 5**
 - **Probability of no forced outages is 0.0000319**
 - **Probability of forced outage MW \leq 20 MW is 0.001379**
 - **Mean 289.4MW**
 - **Standard Deviation 192.1MW**


Probability Density – Online Generation

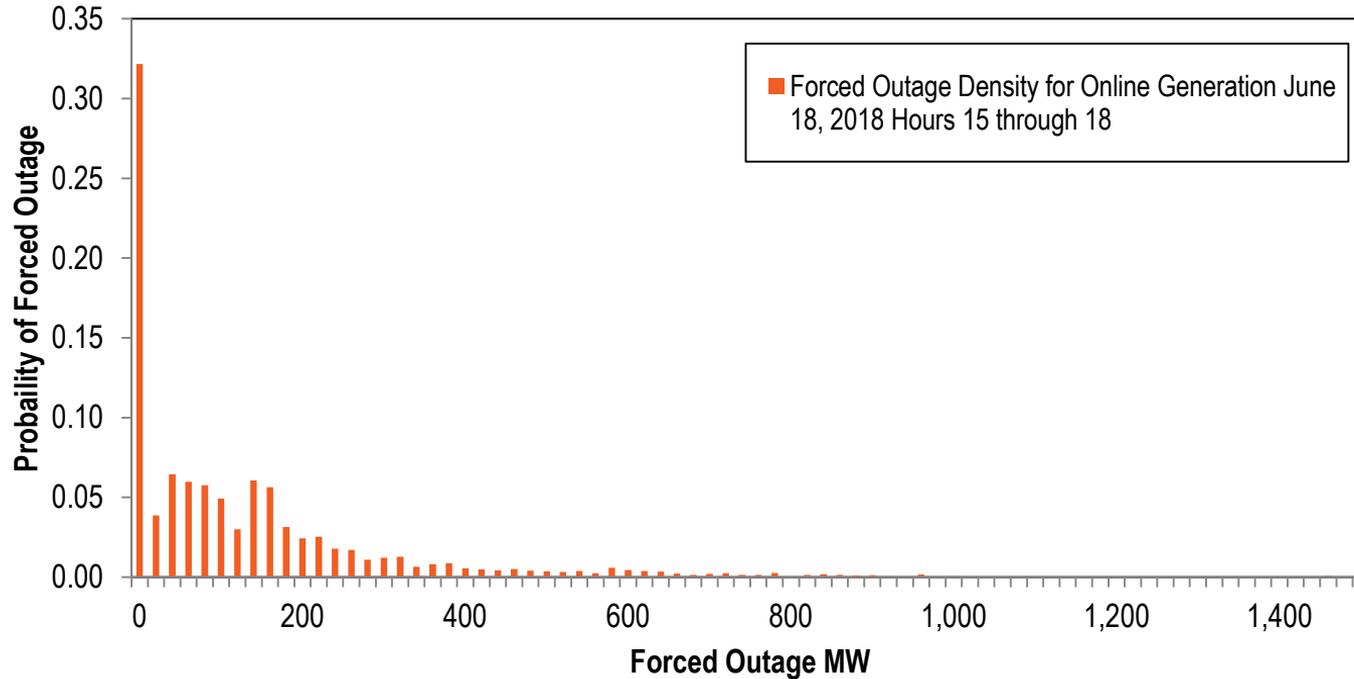

Probability Density – All Generators

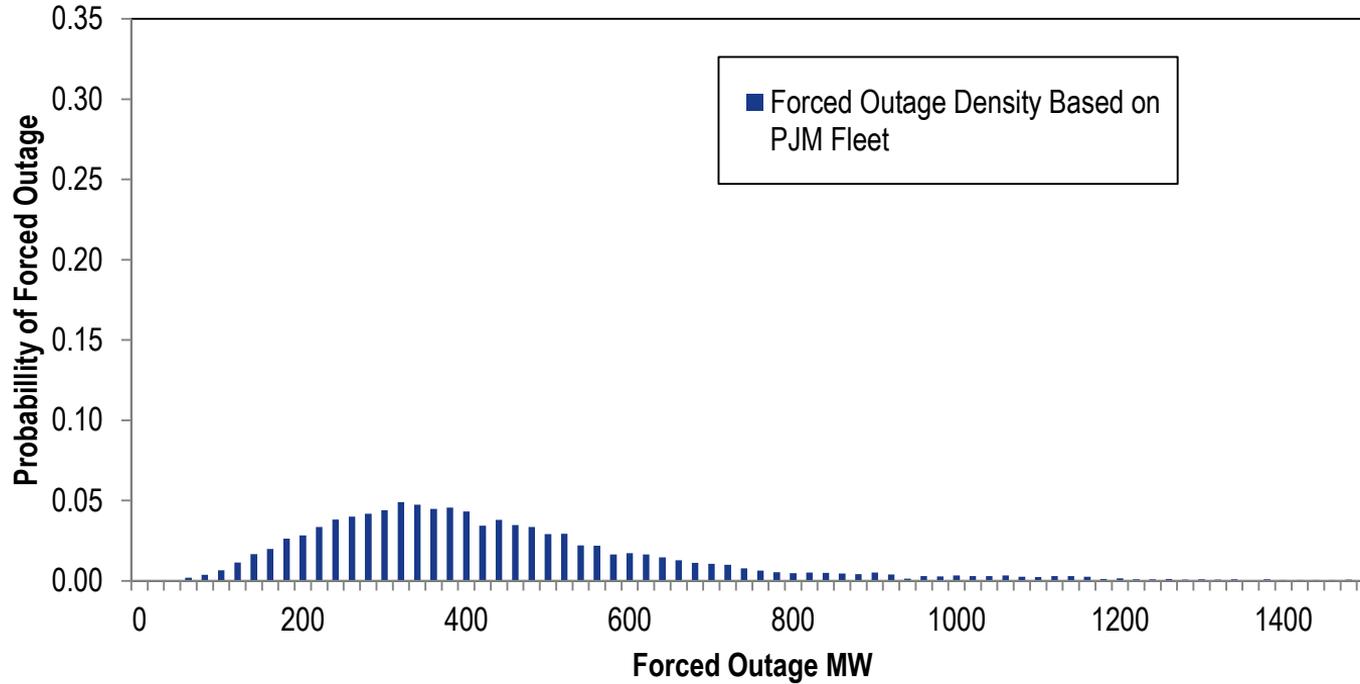

Probability Density – All Generators (Adjusted)

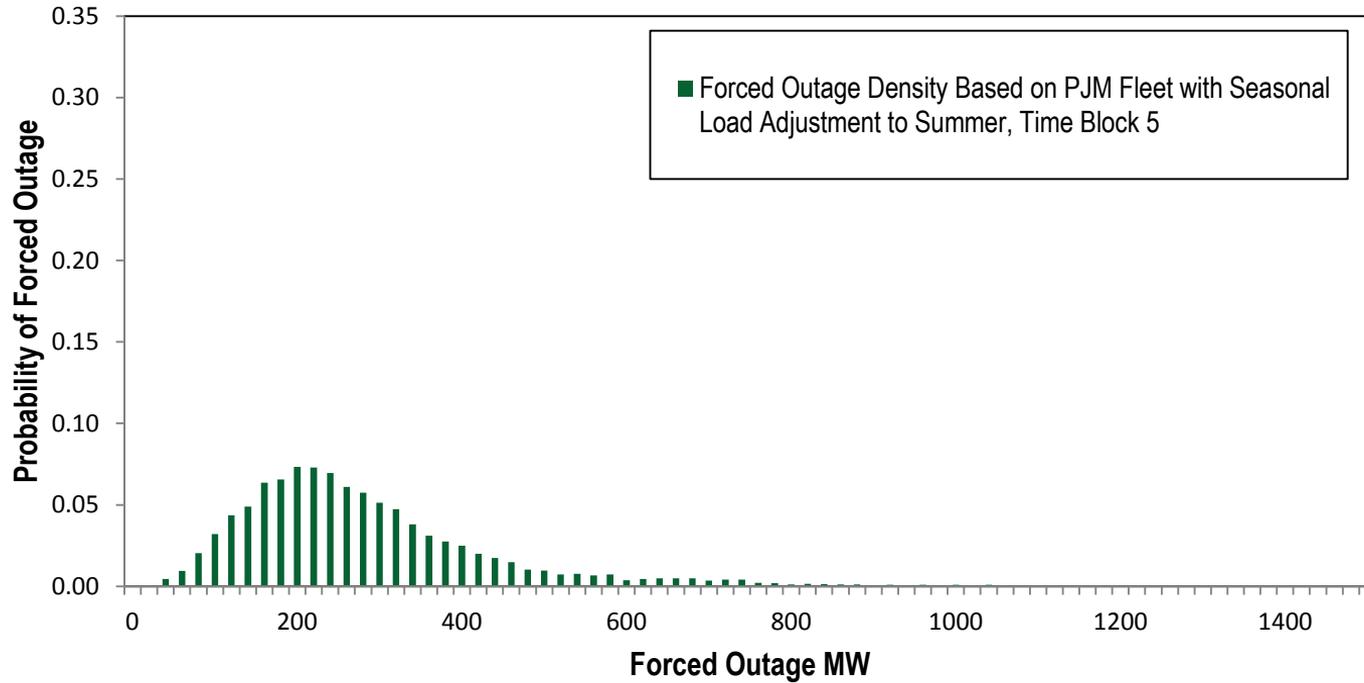


Impact on ORDCs

Reserves	Excess Above MRR (including RR Shift)	Forced Outage MW Level	PJM Method		Online Generation for June 18, 2018, Hours 15 - 18		Price Difference
			Adjusted PBMRR	Price (Adjusted PBMRR x \$850)	Adjusted PBMRR	Price (Adjusted PBMRR x \$850)	
0	-1400		1.000	\$850.0	1.000	\$850.0	\$0
1400	0		1.000	\$850.0	1.000	\$850.0	\$0
1475	75	600	0.382	\$324.8	0.279	\$237.4	\$87
1575	175	700	0.311	\$264.5	0.220	\$187.2	\$77
1675	275	800	0.248	\$210.6	0.170	\$144.9	\$66
1775	375	900	0.193	\$164.0	0.129	\$109.7	\$54
1875	475	1000	0.147	\$125.0	0.097	\$82.1	\$43
1975	575	1100	0.110	\$93.4	0.071	\$60.1	\$33
2075	675	1200	0.080	\$68.3	0.051	\$43.2	\$25
2175	775	1300	0.058	\$48.9	0.036	\$30.8	\$18
2275	875	1400	0.040	\$34.3	0.026	\$21.7	\$13
2375	975	1500	0.028	\$23.8	0.018	\$15.1	\$9
2475	1075	1600	0.019	\$16.1	0.012	\$10.4	\$6
2575	1175	1700	0.013	\$10.7	0.008	\$7.1	\$4
2675	1275	1800	0.008	\$7.1	0.006	\$4.9	\$2
2775	1375	1900	0.005	\$4.6	0.004	\$3.2	\$1
2875	1475	2000	0.003	\$2.9	0.002	\$2.1	\$1
2975	1575	2100	0.002	\$1.8	0.002	\$1.3	\$0




Impact on ORDC

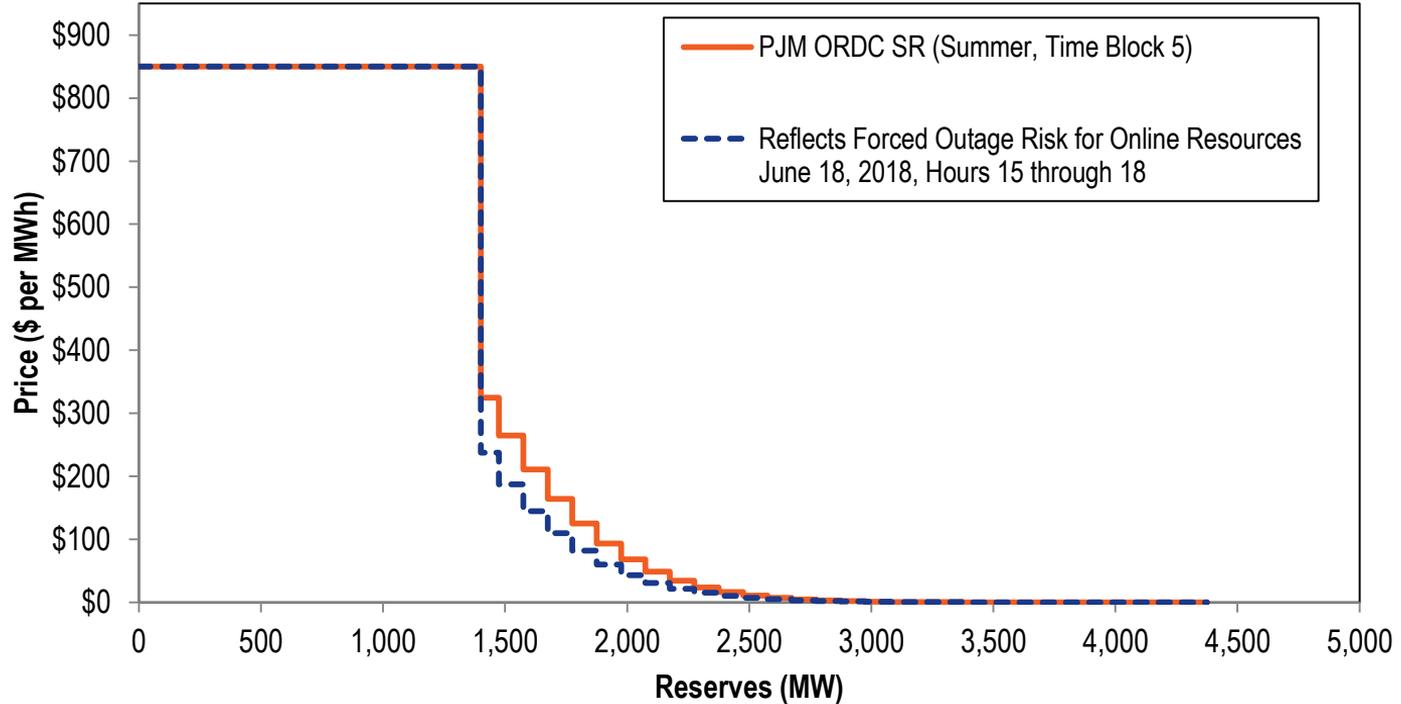

Impact on ORDCs

Reserves	Excess Above MRR (including RR Shift)	Forced Outage MW Level	PJM Method		Online Generation for July 25, 2018, Hours 3 - 6		Price Difference
			Adjusted PBMRR	Price (Adjusted PBMRR x \$850)	Adjusted PBMRR	Price (Adjusted PBMRR x \$850)	
0	-1400		1.000	\$850.0	1.000	\$850.0	\$0.0
1400	0		1.000	\$850.0	1.000	\$850.0	\$0.0
1500	100	900	0.073	\$61.7	0.052	\$44.1	\$17.6
1600	200	1000	0.053	\$44.8	0.039	\$33.3	\$11.5
1700	300	1100	0.039	\$32.8	0.030	\$25.3	\$7.5
1800	400	1200	0.028	\$24.0	0.022	\$18.4	\$5.5
1900	500	1300	0.020	\$17.3	0.016	\$13.4	\$3.9
2000	600	1400	0.015	\$12.4	0.011	\$9.6	\$2.9
2100	700	1500	0.010	\$8.7	0.008	\$6.6	\$2.1
2200	800	1600	0.007	\$5.9	0.005	\$4.7	\$1.2
2300	900	1700	0.005	\$3.9	0.004	\$3.2	\$0.7
2400	1000	1800	0.003	\$2.6	0.003	\$2.3	\$0.3
2500	1100	1900	0.002	\$1.7	0.002	\$1.5	\$0.2
2600	1200	2000	0.001	\$1.1	0.001	\$1.0	\$0.1
2700	1300	2100	0.001	\$0.7	0.001	\$0.7	\$0.0
2800	1400	2200	0.001	\$0.5	0.001	\$0.5	\$0.0
2900	1500	2300	0.000	\$0.3	0.000	\$0.4	-\$0.1
3000	1600	2400	0.000	\$0.2	0.000	\$0.2	\$0.1


Impact on ORDC

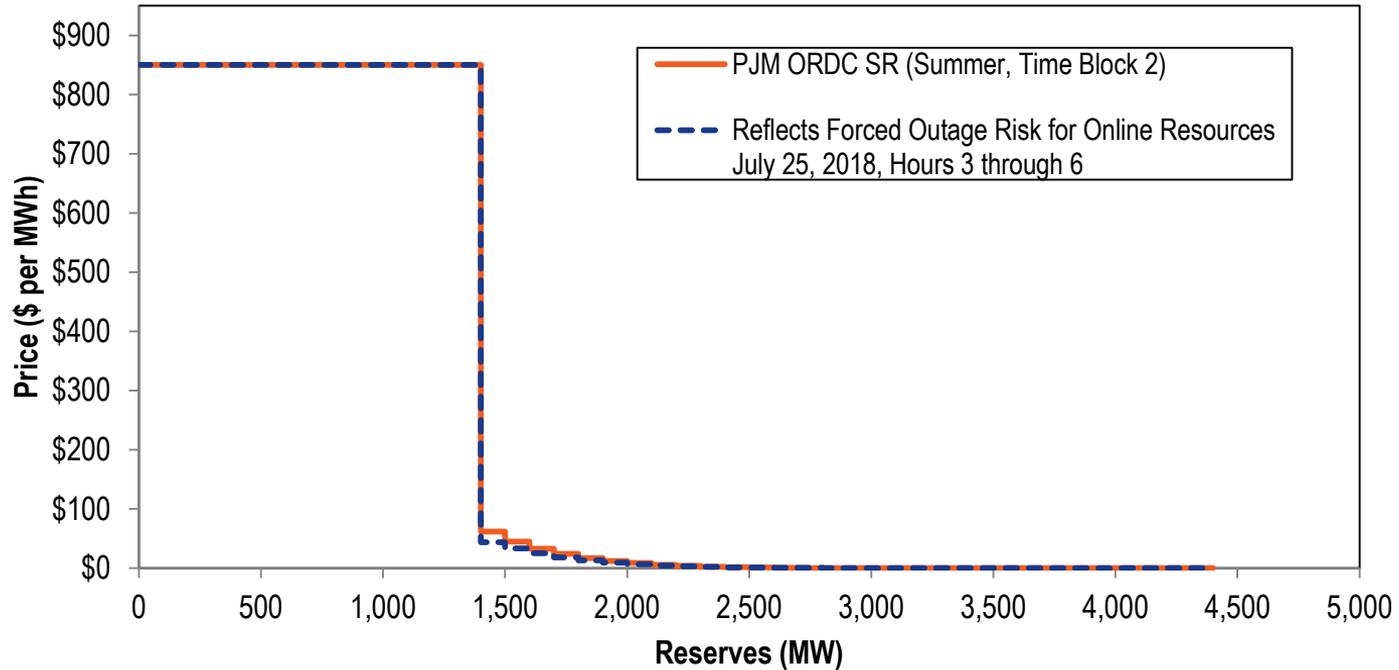

Impact on ORDCs

Reserves	Excess Above MRR (including RR Shift)	Forced Outage MW Level	PJM Method		Online Generation for January 16, 2018, Hours 11 - 15		Price Difference
			Adjusted PBMRR	Price (Adjusted PBMRR x \$850)	Adjusted PBMRR	Price (Adjusted PBMRR x \$850)	
0	-1400		1.000	\$850.0	1.000	\$850.0	\$0
1400	0		1.000	\$850.0	1.000	\$850.0	\$0
1475	75	600	0.323	\$274.1	0.217	\$184.6	\$90
1575	175	700	0.258	\$219.0	0.168	\$142.4	\$77
1675	275	800	0.202	\$171.6	0.125	\$106.4	\$65
1775	375	900	0.154	\$130.8	0.094	\$79.6	\$51
1875	475	1000	0.115	\$97.8	0.068	\$57.9	\$40
1975	575	1100	0.085	\$71.9	0.047	\$40.2	\$32
2075	675	1200	0.060	\$51.2	0.034	\$28.7	\$22
2175	775	1300	0.042	\$35.7	0.024	\$20.2	\$15
2275	875	1400	0.029	\$24.7	0.017	\$14.2	\$11
2375	975	1500	0.020	\$16.9	0.012	\$10.5	\$6
2475	1075	1600	0.014	\$11.6	0.009	\$8.0	\$4
2575	1175	1700	0.010	\$8.3	0.007	\$5.9	\$2
2675	1275	1800	0.007	\$6.1	0.005	\$4.6	\$2
2775	1375	1900	0.005	\$4.5	0.004	\$3.4	\$1
2875	1475	2000	0.004	\$3.4	0.003	\$2.6	\$1
2975	1575	2100	0.003	\$2.6	0.002	\$2.0	\$1

Impact on ORDC

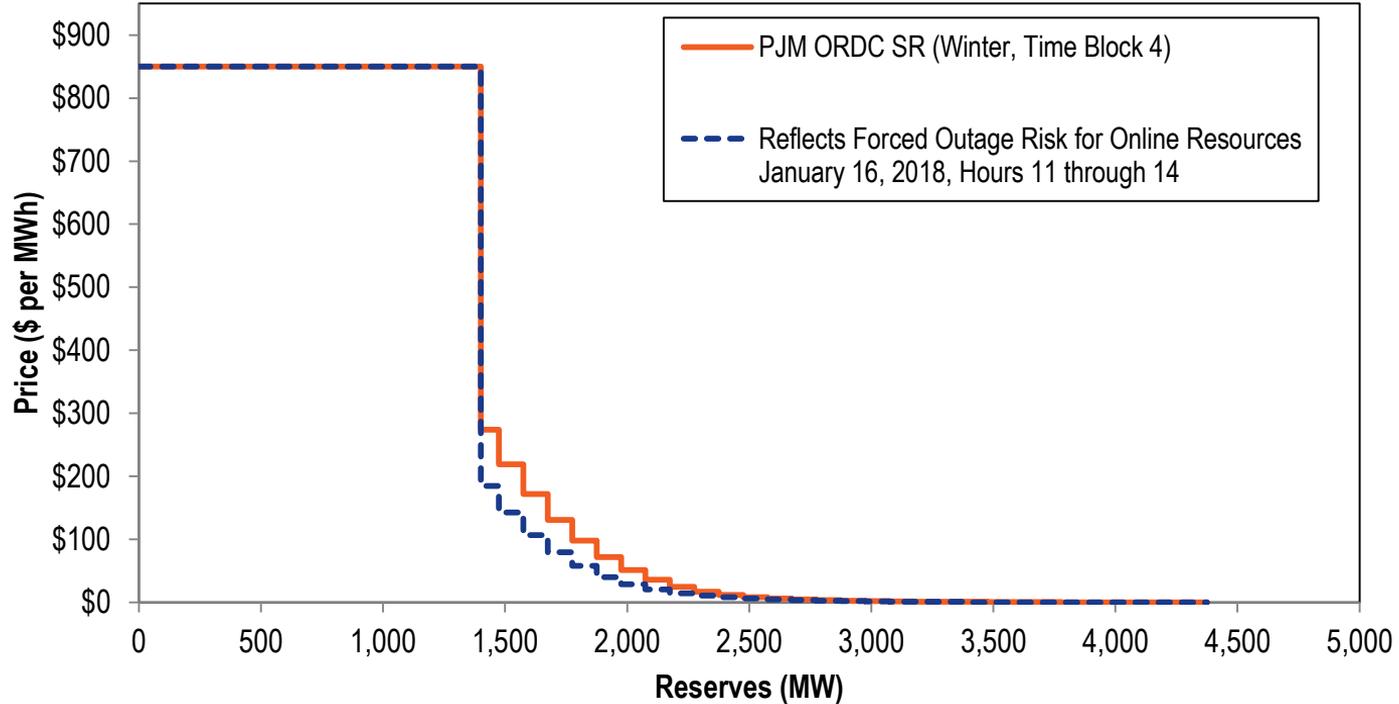

Terms

- **ORDC – Operating Reserve Demand Curve**
- **MRR – Minimum Reserve Requirement**
- **Excess Above MRR (including RR shift) – the excess above the minimum reserve requirement after an adjustment to account for the regulation requirement.**
- **PBMRR – Probability (of falling) below the minimum reserve requirement**



Monitoring Analytics, LLC

2621 Van Buren Avenue

Suite 160

Eagleville, PA

19403

(610) 271-8050

MA@monitoringanalytics.com

www.MonitoringAnalytics.com

